

DESIGN, CONSTRUCTION AND PERFORMANCE OF
STICK-WOOD FIRED FURNACE
FOR RESIDENTIAL AND SMALL COMMERCIAL APPLICATION

RICHARD C. L

UNIVERSITY OF MAINE

ORONO, MAINE

04469

PERIOD: SEPTEMBER 1, 1977 TO

AUGUST 31, 1979

DATE OF REPORT: OCTOBER 1979

* PREPARED FOR THE U.S. DEPARTMENT OF ENERGY: CONTRACT EC 77-S-02-45

DISCLAIMER

THIS REPORT WAS PREPARED AS AN ACCOUNT OF WORK SPONSORED BY THE UNITED STATES GOVERNMENT. NEITHER THE UNITED STATES NOR THE UNITED STATES DEPARTMENT OF ENERGY, NOR ANY OF THEIR EMPLOYEES, MAKES ANY WARRANTY, EXPRESS OR IMPLIED, OR ASSUMES ANY LEGAL LIABILITY OR RESPONSIBILITY FOR THE ACCURACY, COMPLETENESS, OR USEFULNESS OF ANY INFORMATION, APPARATUS, PRODUCT, OR PROCESS DISCLOSED, OR REPRESENTS THAT ITS USE WOULD NOT INFRINGE PRIVATELY OWNED RIGHTS.

COPYRIGHT NOTICE

BY ACCEPTANCE OF THIS REPORT, THE PUBLISHER AND/OR RECIPIENT ACKNOWLEDGES THE U. S. GOVERNMENT'S RIGHT TO RETAIN A NONEXCLUSIVE, ROYALTY-FREE LICENSE IN AND TO ANY COPYRIGHT COVERING THIS REPORT.

Abstract

With funding from ERDA and DOE an experimental program was conducted at the University of Maine at Orono to develop a combustion system for residential furnaces that solves the traditional problem of wood burning: inefficiency, air pollution and fire hazzard.

The program led to the designs that are now covered by a patent application and are being manufactured by three companies:

Dumont Industries
Monmouth, Maine 04259

Madawaska Wood Furnace Company
86 Central Street
Bangor, Maine 04401

Hampton Technologies Corporation Ltd.
Box 2277
126 Richmond Street
Charlottetown, Prince Edward Island, Canada C1A 8B9

This report is an abbreviated summary of the history, the design, the performance, and the construction of pro-to-type production units.

I. A HISTORY OF THE PROJECT

First efforts leading to the present work were sponsored by the Audubon Society and Georgia Pacific Company.

Current Contract:

Fall and winter 1977-1978 - design and test various configurations for stick-wood combustion schemes.

Spring and summer 1978 - integrate designs into a heat exchanger and storage system.

Fall and winter 1978-1979 - refine design and construct sample units.

Spring and summer 1979 - construct production pro-to-type and testing.

II. THE PROBLEM OF BURNING WOOD

A series of very complex time-and-temperature-dependent chemical reactions accompany the burning of wood. To supply the correct amount of air is difficult; to control the output to match a particular heating load is impossible. This difficulty in carburetion and control is compounded by difficulties in ignition. The pyrolysis gases generated from heating wood have an ignition temperature between 725^oF (methanol) and 1128^oF (carbon monoxide). Since stove surface temperatures do not operate in this range, much of the gas distilled from wood is vented to the chimney with three unhappy consequences:

1. the loss of energy
2. the pollution of the atmosphere
3. chimney condensation with subsequent fire hazard.

As stick wood is burned, heat is transferred from the surface to the interior with a counter flow of pyrolysis material. The kinetics of the reaction depend upon:

1. surface-to-volume ratio of the stick
2. surface temperature
 - a. radiant field
 - b. convection field
3. wood moisture
4. specie
5. rate of air supply
6. rate of ash removed from the burning surface.


Given this complexity, the only design approach is to cut and try. The only design rule is to keep the combustion zone hot and turbulent for a sufficient time to complete the reaction.

At the start of the present work, several arrangements of all-refractory combustion chambers were tried without real success. Regardless of how the air was introduced or the wood stacked, the radiative capacity of the refractory would force carburetion problems that would sometimes result in explosions strong enough to lift a twenty-pound case-refractory charging door.

III. A DESCRIPTION OF THE FINAL DESIGN

1. Summary

The elements of a satisfactory stick wood furnace are shown in the schematic sketch below.




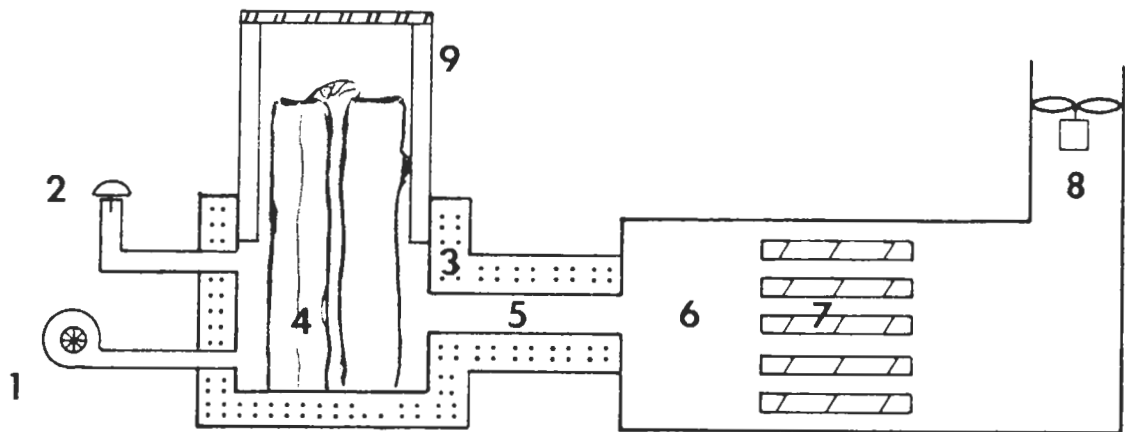


- | | |
|-----------------------|----------------------------------|
| 1 - forced draft fan | 6 - low velocity ash chamber |
| 2 - secondary air | 7 - fire tube heat exchanger |
| 3 - refractory base | 8 - induced draft fan |
| 4 - stacked wood | 9 - water jacket for wood charge |
| 5 - refractory tunnel | |

Figure 1

The forced draft fan supplies combustion air at 3 inches of water static (about 100 ft/sec). The water jacket limits the pyrolysis to the refractory base. The 1500°F⁺ tunnel provides mixing and ignition. The induced draft fan provides easy starting, smoke free loading and compact heat exchanger design. Figure 2 shows the configuration of the final design.

1M¹ stake 16/hr
100
23 ~~cfm~~ cfm

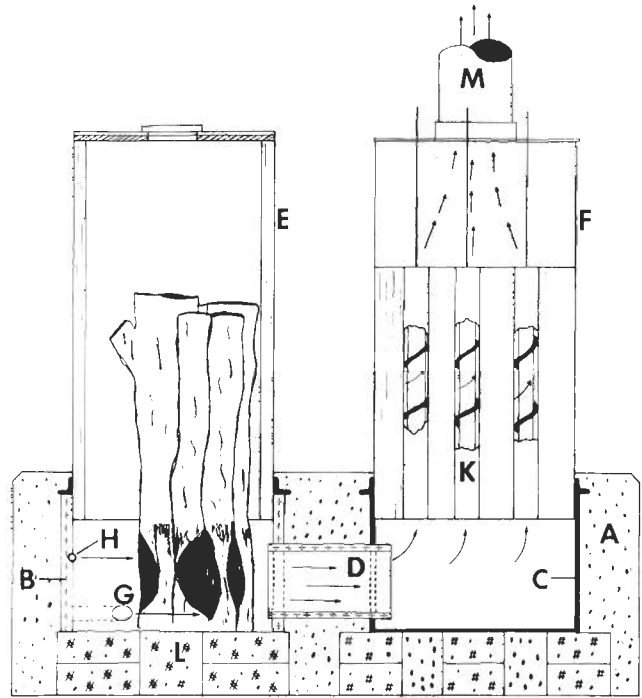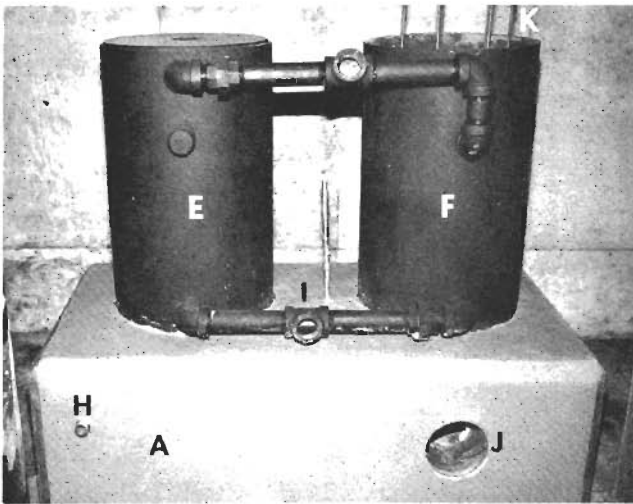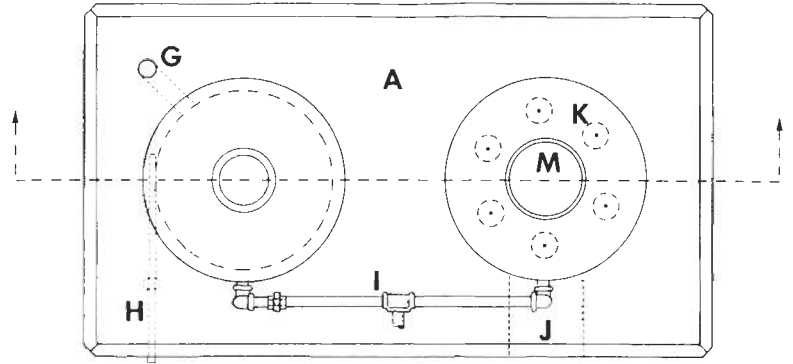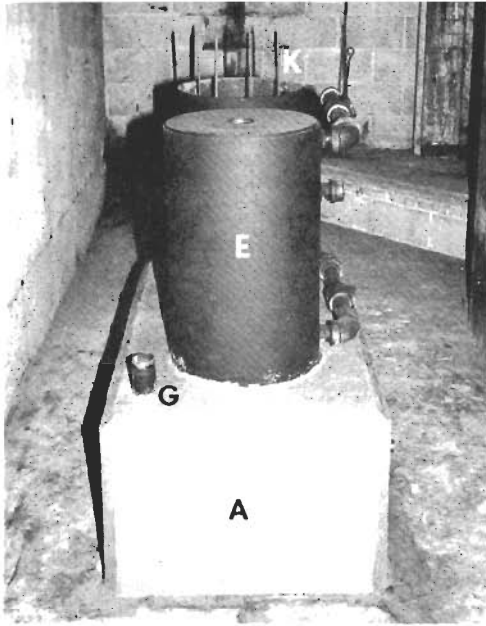

- A - Vermiculite base
- B - Refractory ring (Plicast 27)
- C - Refractory ring (LWI 20)
- D - Refractory tunnel
- E - Combustion can
- F - Heat exchanger
- G - Secondary air inlet

- H - Primary air (stirring air)
- I - Connections to storage tank
- J - Ash cleanout
- K - Turbulators
- L - Fire brick
- M - Connection to smoke pipe
(not shown on photograph)

Figure 2

2. The Forced Draft Blower and Air Supply System

Figure 3 shows the flow-pressure characteristics of the forced and induced draft fans. The combustion of 20 pounds of dry wood per hour requires about 130 lb of air per hour at zero excess air. The efficiency penalty at a 300°F stack is only three percentage points if 75% excess air is introduced. This extra air assures pollution free combustion. Hence about one half the air is introduced by the Spencer blower, the rest is pulled in by the ID fan through the secondary air port.

This secondary flow tends to be self regulating. As the combustion rate increases the volume flow rate increases. The associated pressure drop through the system forces the combustion chamber pressure close to atmospheric. The result: less secondary air and a tendency to stabilize the combustion rate.

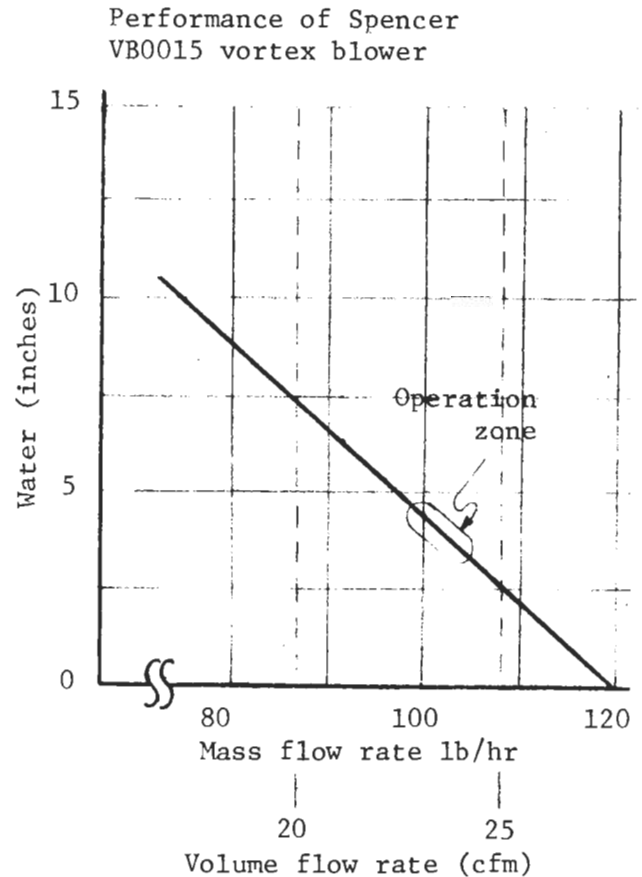
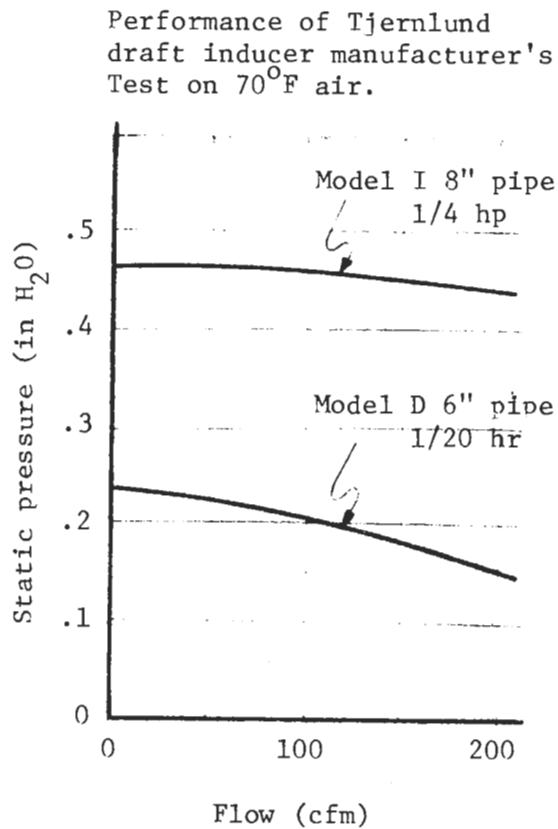


Figure 3


3. The Refractory System

Figure 4 shows the refractory base -- the water jacket fits inside -- the charge air pipe is about one inch below the jacket.

Ideally the refractory base should have low heat capacity and low thermal conductivity to provide rapid temperature rise for quick smokeless starts. Refractories with these properties, however, are too soft to stand the abrasion of loading wood and the erosion of high velocity particles.

The following compromise has worked well:

Combustion zone - 2" PLICAST 27
 Tunnel - 1" PLICAST 27
 Base of heat exchanger - 2"
 PLICAST LWI 20

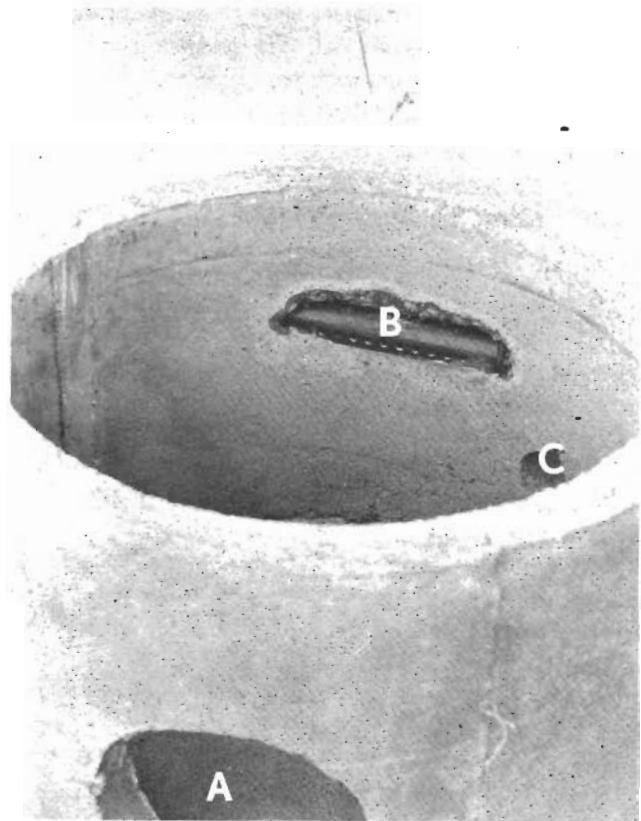

A - the entrance to the tunnel
 B - the one inch charge air pipe with ten 1/4" holes
 C - the secondary air port

Figure 4

Figure 5 shows the forms used to cast the combustion zone refractory; the heat exchanger base and the tunnel.

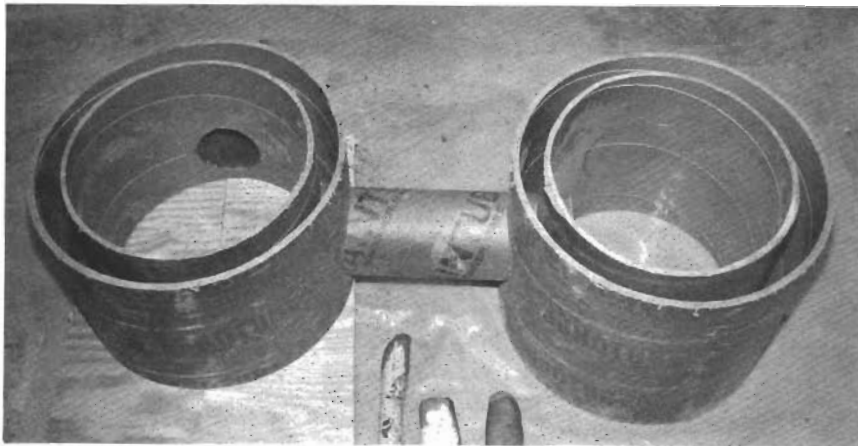


Figure 5

These materials, by themselves, would not provide the necessary thermal protection or prevent in-leakage of unwanted air. Therefore the assembly is cast in vermiculite concrete covered with BLOCKBOND to provide protection. The finished unit is shown in Figure 2. An ash cleanout port is shown under the heat exchanger; the forced air pipe is shown on the left.

The properties of the refractory and vermiculite are shown in the Appendix.

4. The Heat Exchanger and Combustion Can

A thirty-inch length of 16" diameter schedule 10 pipe was fitted with two tube sheets and seven 2 1/2" fire tubes 20" long. The unique turbulators shown in Figure 6 have extensions through the smoke collar which can be pulled while the unit is operating to remove dust. The combustion can was formed by welding a 14" diameter pipe inside a 16" diameter pipe.

Figure 7 shows the heat exchanger with smoke pipe removed. Fly ash is discernable on the top tube sheet, but no condensable combustibles are present in spite of attempts to burn 50-60 percent moisture (wet basis) wood.

*rod is 3/8 rod,
inside pipe is 1 3/4?*

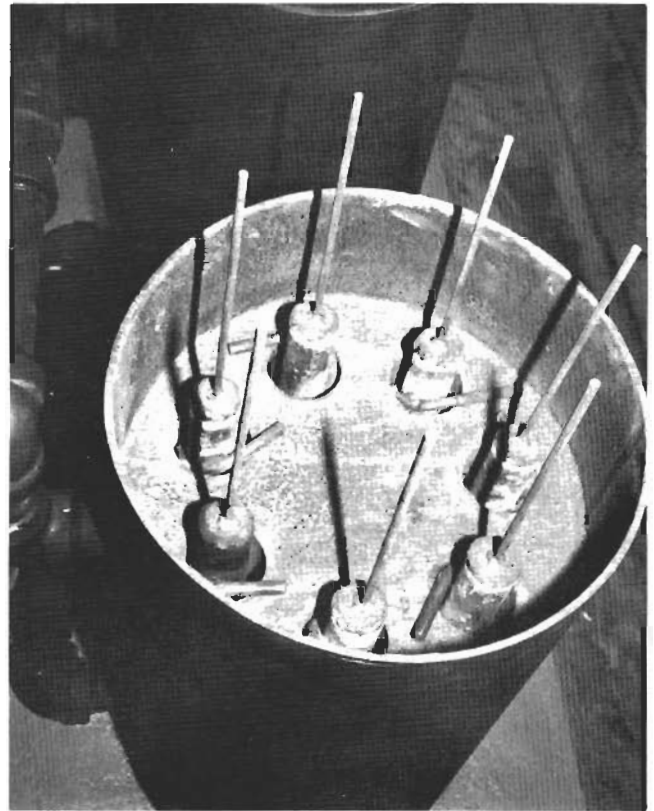


Figure 6

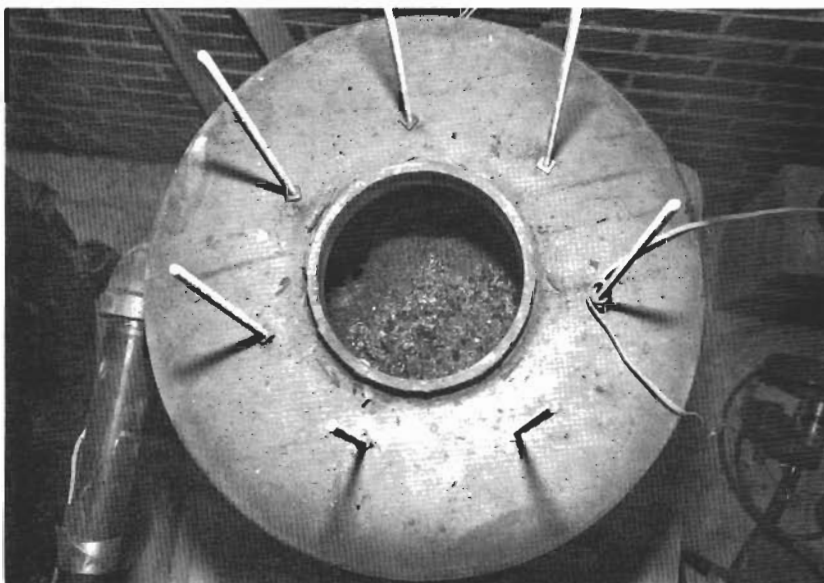


Figure 7

The heat exchanger and combustion can are connected to a storage system through pipes large enough to permit gravity circulation. An open-to-the-atmosphere expansion tank will prevent overpressure.

5. Interaction with Building Heat Load

The open tees of Figure 2 are connected to two cross-connected 275 gal oil tanks. Figure 8 shows the assembly before the tanks were placed on legs and connections made. An open expansion tank is installed above the highest radiation in the building. Standard circulator pump and thermostats respond to building load. The unit can be fired at the convenience of the operator independent of heating load at the moment. A pound of wood will increase the system temperature about one degree F.



Figure 8

6. The Control of Corrosion

Ten pounds of sodium chromate or a nitrite-borate mixture added to 1,000 gal of water provides good corrosion protection for closed systems. If a domestic hot-water heat exchanger is used, provision must be made to prevent the chromate or nitrite from being syphoned into the potable supply.

IV. PERFORMANCE

1. Start-up and Shut-down

Place seven pounds of dry softwood sticks (2 x 4 ends are good) mixed with about two pounds of newspaper in the bottom of the combustion can. Start the ID fan. Drop a lighted newspaper into the can. A fire will be established at once.

Add stick wood (the amount will depend upon the weather, the temperature of the storage, and the heat loss characteristics of the building). Close the air tight cover and turn on the forced draft fan. The unit will now operate at steady state for about two hours if forty pounds of wood are added.

The secondary air damper position is "open" during start-up when the large surface area of kindling demands much air. After ignition the damper can be changed to a "run" position. The setting will depend upon the surface area of the wood, wood moisture, chimney height and ID fan characteristics. If the wood is very dry and finely divided (small scrap from a wood working shop for example) the pyrolysis process may proceed faster than air can be supplied. The fuel-rich, air-lean condition will reduce the combustion rate and slow the pyrolysis process. The constant forced air supply will soon return the combustion zone to the stoichiometric state. The result: a small "bump" will occur forcing combustion products back through the secondary air port. A pad of coarse steel wool should be placed in this pipe to act as a flame suppressor.

An open-on-temperature-drop thermostat in the stack can shut off both fans when the stack temperature falls below 250°F.

Figure 9 and 10 show a stick after about forty minutes in the combustion chamber. The length is about half the original length. Note that pyrolysis is confined to the refractory zone.



Figure 9



Figure 10

2. Efficiency

The energy content of each pound of bone dry wood is close to 8,600 Btu. If the energy of the stack gas can be determined, then the difference is the energy release rate:

1. "input" for each lb of dry fiber 8,600
2. stack energy for each lb of dry fiber including the steam associated with the initial wood moisture XXXXX
3. difference is gross output YYYYY

If combustion is complete, stack gas consists of oxygen (from the excess air), water vapor, carbon dioxide and nitrogen. The energy of these gases is a function of temperature alone; hence item (2) above can be calculated. Chapter VII explains these calculations in detail.

Chapter VI describes the tests that lead to the assumption of complete combustion. Figure 11 is an efficiency map of seven tests (thirty percent moisture wood - wet basis). All eighty data points fall within the shaded zone. Start-up (A) tends to have low stack temperature because the refractories and heat exchanger are cold; and low excess air because the kindling has much surface area and combustion tends to be close to stoichiometric. The bulk of the running time is in zone (B). Zone (C) is the shut down condition. The surface area of the wood tends to be low and excess air tends to be high. Prompt shut down is necessary to avoid losses associated with pulling much excess air through the refractories and heat exchanger.

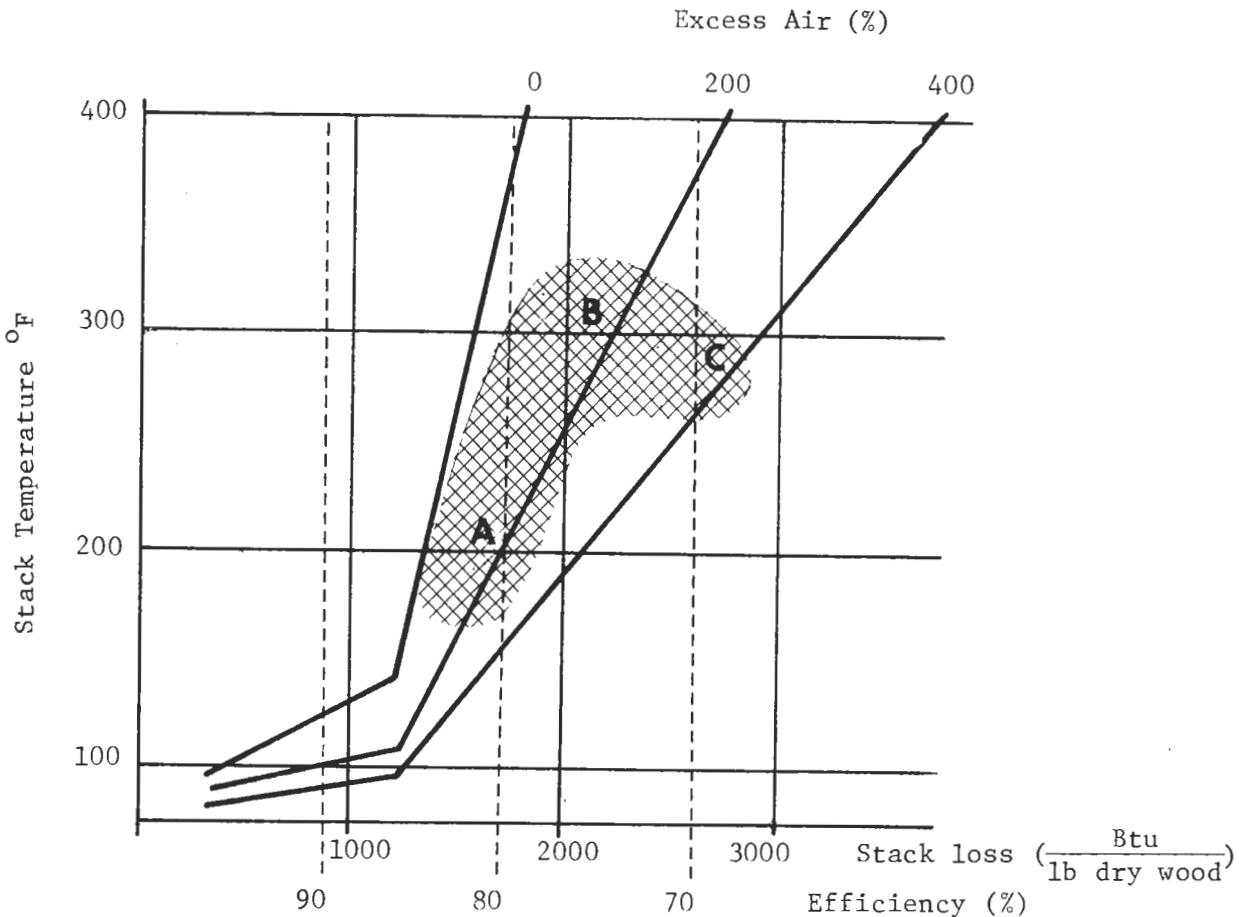


Figure 11

With an induced draft fan very low stack temperatures are possible. The 300°F stack temperature reported here is a practical lower limit. At 300°F there is sufficient stack buoyancy to purge smoke from the system in the event of a power failure. The "knee" of the excess air lines at stack temperatures between 95°F and 135°F reflect the dew point of the combustion gas.

3. Wood Arrangement

Figure 12 indicates satisfactory wood arrangements; Figure 13 unsatisfactory arrangements. The single unsplit log will burn if introduced into already hot refractory, but with the efficiency penalty of high excess air. The pine slab wood exposes too much surface and fuel-rich, air-lean "bumping" will result.



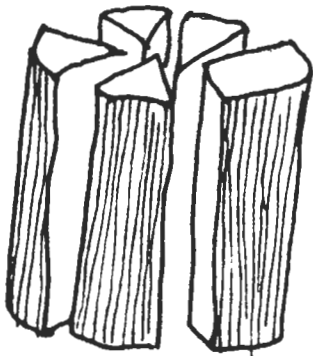


Figure 12

Optimum Wood Configurations

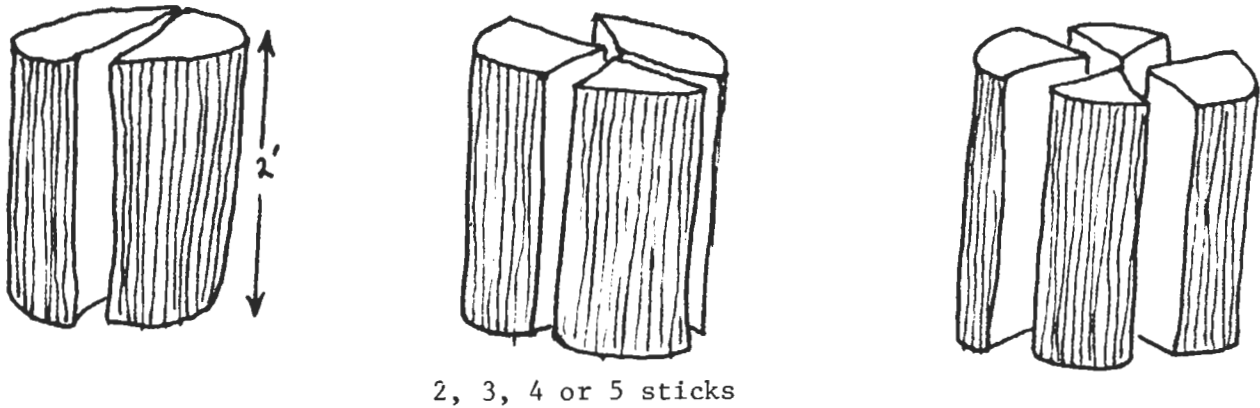

unsplit log

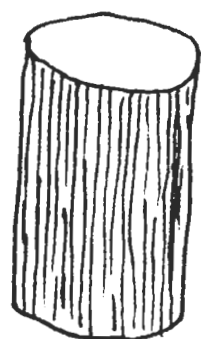

pine slabwood

Figure 13

The key to constant-output combustion is the mode of stirring air entry.

If the wood burns to a point as shown in Figure 14, the surface area exposed decreases and output will fall. If the air can be introduced to force an "hourglass" combustion pattern (Figure 15) the stick will break off and drop fresh wood into the combustion zone. This will hold the output constant from first ignition to final burnout. A one-inch pipe with ten 1/4" holes as shown in the photographs (see Figure 4) worked well.

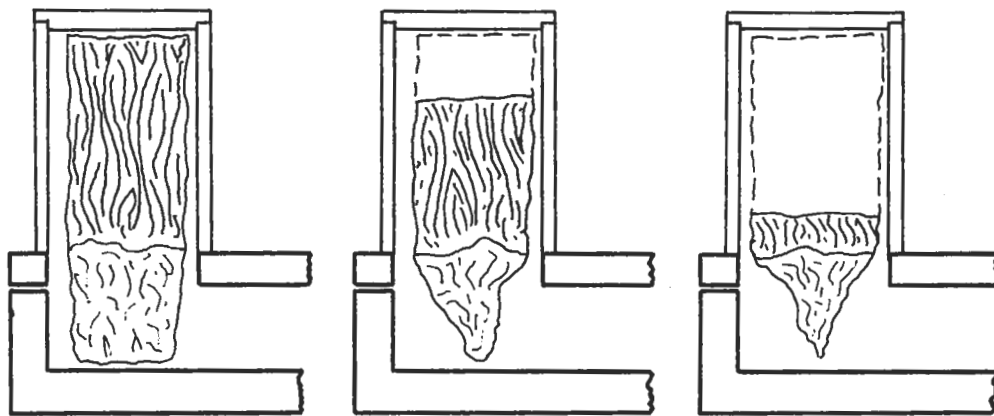


Figure 14

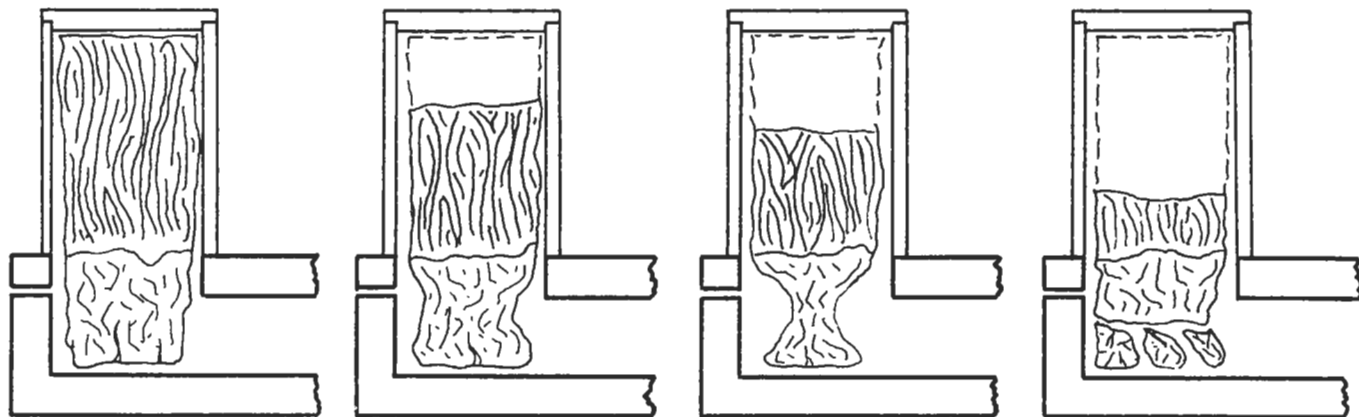


Figure 15


4. The Thirteen Hour Test

Figure 16 shows performance data for a 13 hour test. The wood was 27% moisture (wet basis) and the "wood charged" includes this moisture. The "temperature outside the refractory" is in the vermiculite base that surrounds the refractory. The "tunnel temperature" was measured by an unshielded thermocouple in the tunnel. City water was passed through the storage tank. The output (about 100,000 Btu/hr) was measured from the flow rate of this water and its temperature rise. No insulation was used. Between the 3rd hour and the 10th hour 180 lb of wood were added. The energy gained by the circulating water was 700,000 Btu. The "as fired" wood energy is about 6,000 Btu/lb. The efficiency based on this data is about 65%. The difference between this efficiency and the 70-80% reported earlier is the heat loss from the uninsulated tank, combustion can, heat exchanger, etc.

As a new batch of wood is added the CO_2 will rise - new wood has a greater surface and with a fixed air supply the combustion tends to approach stoichiometric. This increase in combustion rate does not tend to be reflected in an increase in stack temperature. The moisture in the "green charge" will absorb the added energy release. The erratic tunnel temperature reflects the irregular way the wood drops due to the "hourglass" geometry of a burning log and its subsequent fall into the refractory zone. Figure 17 shows the experimental facility.


5. Green Wood

Several attempts were made to burn green fir (60% moisture wet basis) without success -- the fire simply went out. When mixed with some dry (30% moisture) hard wood, however, it burned satisfactorily (Maine has several hundred thousand acres of bud worm damaged fir -- an immediate use for this material would be helpful).

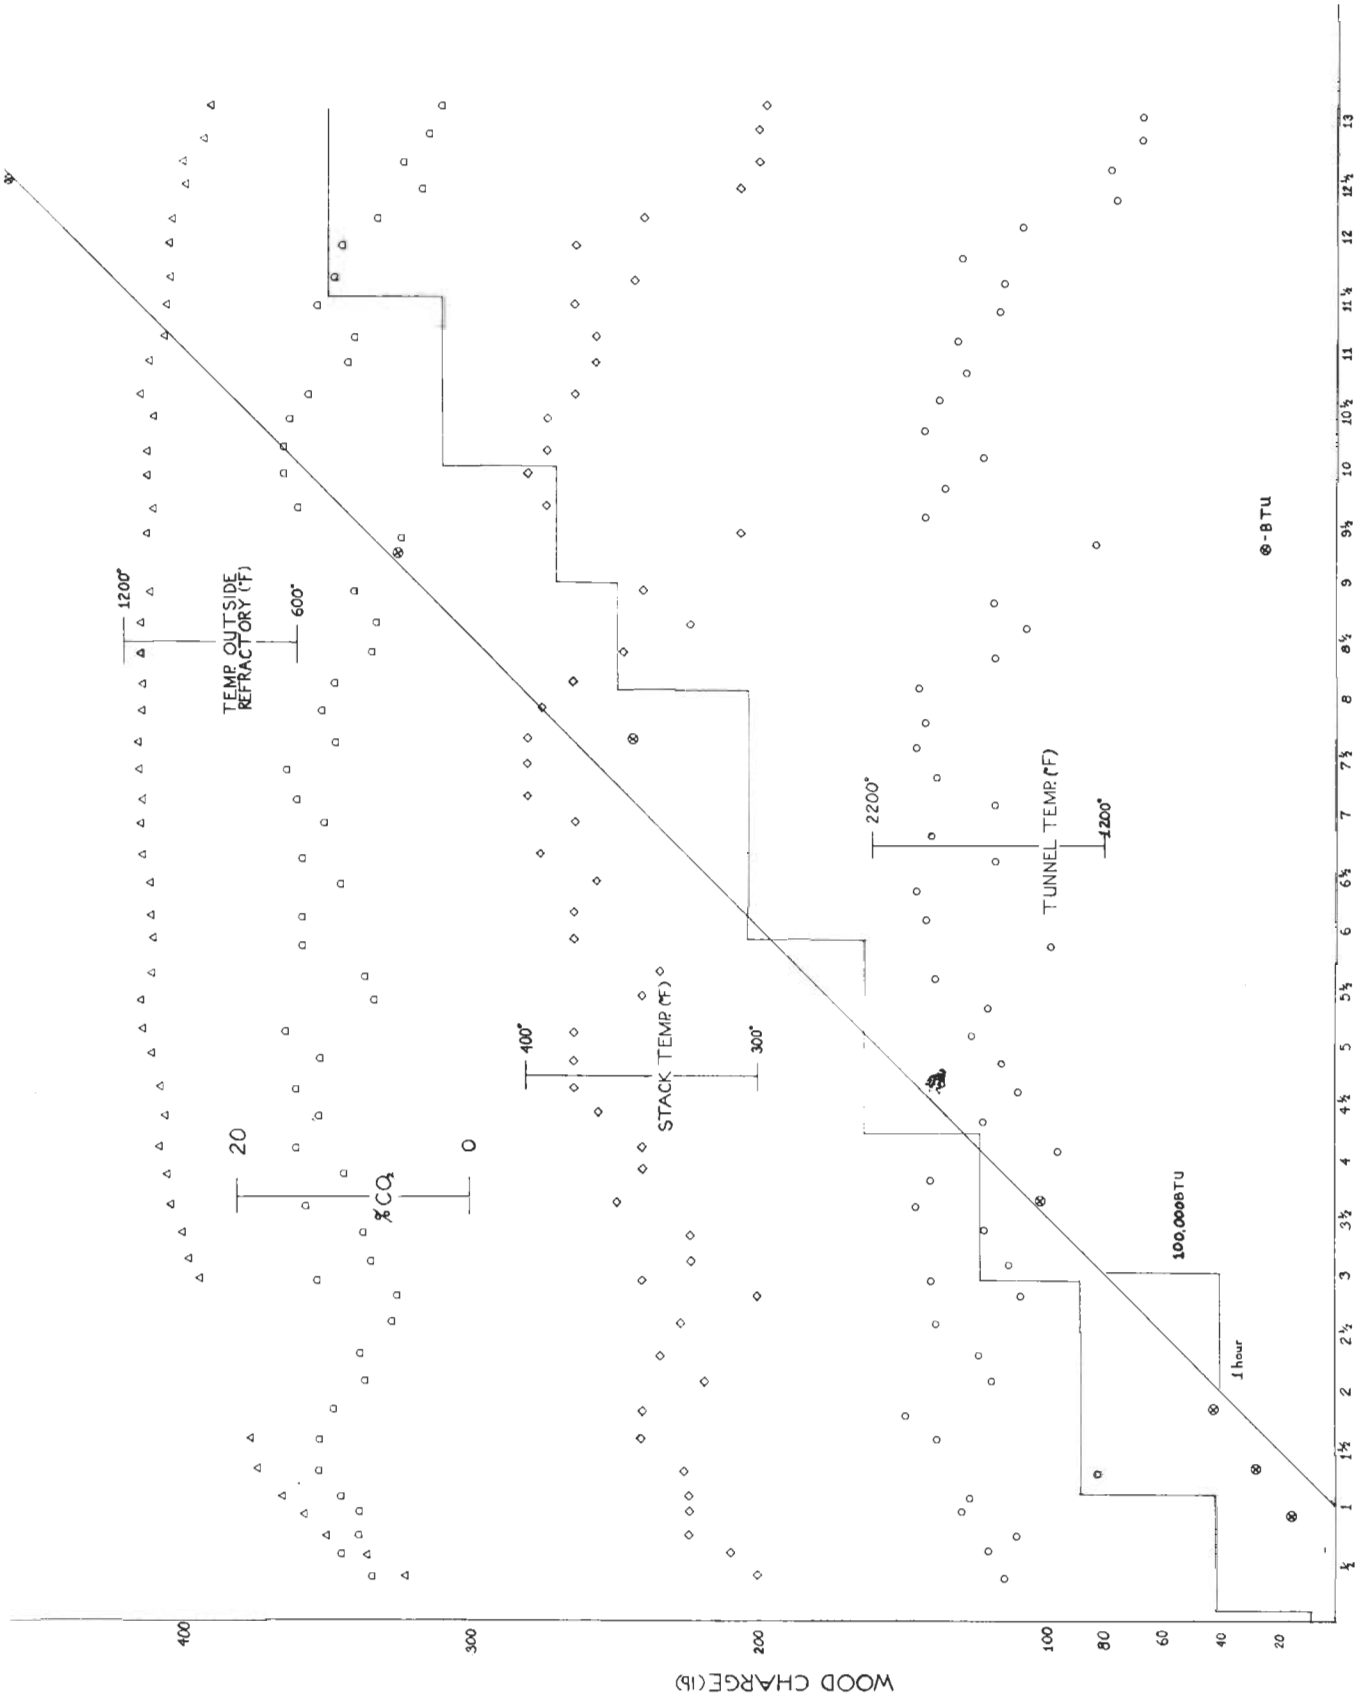

TIME (hrs)

Figure 16

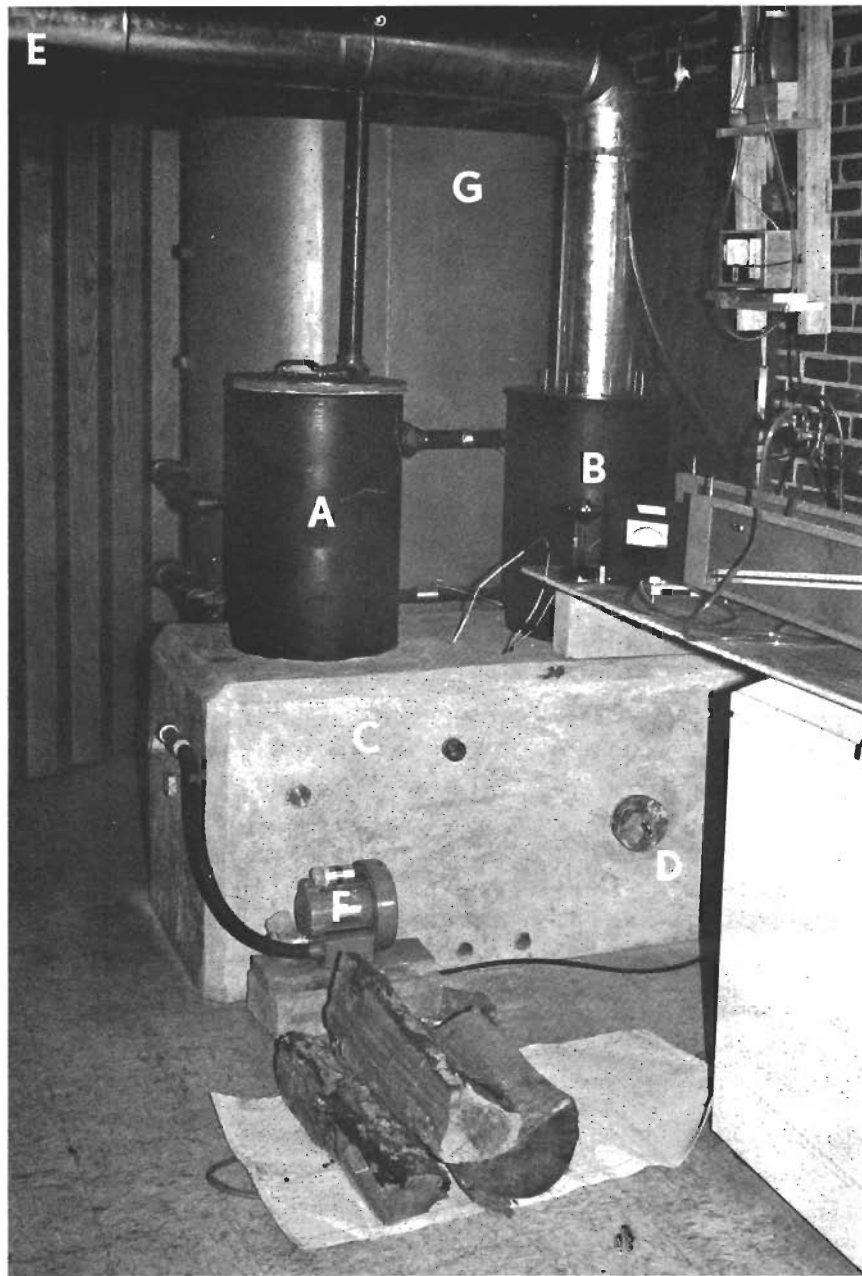

- | | |
|--|------------------|
| A - combustion can | D - ash cleanout |
| B - heat exchanger can | E - to ID fan |
| C - vermiculite case
covered with BLOCKBOND | F - FD fan |
| | G - storage tank |

Figure 17

V. SCHEMES AND DEVICES ATTEMPTED AND REJECTED

1. Several all-refractory combustion chambers were tried. The hope: if the chamber could be air-tight the wood storage zone could be kept fuel-rich and air-lean so that combustion could take place only in the bottom zone where the air is supplied. But the temperature rise in the storage area became so high that pyrolysis proceeded uncontrolled. Steady state burns could not be achieved.
2. The obvious advantage of using one fan was tried. The forced draft was omitted and all charge air was pulled into the combustion zone by the ID fan. The fire burned in a traditional wood stove mode: yellow smokey fire, heat exchanger deposits, etc. The high velocity stirring of the FD fan seems essential.
3. Again a single fan was tried. A Quick Draft (P.O. Box 1353, Canton, Ohio) model 05CA-1/2 blower-venturi combination was installed. The venturi aspirated the stack gas; a bleed from the fan became the charge air. The fan required about 1,000 cfm to provide the necessary venturi action. The penalty in noise, power consumption, and added building infiltration load was deemed too great.
4. Using a hot water system restricts the theoretical lower limit of stack temperature to the temperature of the water. A stack-gas-to-charge-air heat exchanger was tried, but the small increase in efficiency did not justify the complexity and pressure drop.
5. The desire for simplicity would suggest that the base be made of appropriate fire brick with the heat exchanger and combustion can placed on top. The units constructed this way could not be maintained sufficiently air tight to prevent uncontrolled dilution of the burning gas. The vermiculite case provides an expansion cushion and a cool envelope that can be sealed against air leakage.
6. The use of outside air for combustion was abandoned. The unit uses about 2,000 ft³/hr for 100,000 Btu/hr. A home may have 10,000 ft³; the furnace charge air is only a small fraction of the necessary building ventilating air; therefore nothing is gained by pulling this air in from outdoors.
7. Round wire brushes were used in the fire tubes as turbulators. The performance was satisfactory, but cost and projected life were unsatisfactory.

VI. EVIDENCE OF COMPLETE COMBUSTION

1. Smoke Spot Testing and Visual Observation

Tar, pitch, creosote, and soot give wood smoke its characteristic blue-gray color. The furnace produces blue-gray smoke only during the first 10 to 20 minutes after start-up. Once the refractory becomes hot, visible emissions cease.

A Bacharach True-spot smoke tester was used and results compared to an oil burner smoke scale. The smoke scale meets ASTM D 2156-63T. Number 0 is whitest and number 9 is blackest. During cold start-up, 10 to 20 minutes after lighting the fire, the smoke spots ranged between 4 and 8. For comparison, traditional wood stoves will produce smoke ranging from 4 to 9.

2. Chimney Condensate Carbon Analysis

Samples of stack gas were cooled to 70°F and condensibles collected. The liquid was analyzed for carbon content.

The total carbon content of the condensate was 3200 ppm or 0.3%. Of this, 5 ppm was inorganic carbon⁵.

Acetic acid (CH₃COOH) and formaldehyde (HCHO) are two pyrolysis products expected in the condensate. If all of the carbon in the condensate were in acetic acid, the sample would contain 0.7% acetic acid. If all of the carbon in the condensate were in formaldehyde, the sample would contain 0.8% formaldehyde.

Of course, the carbon is not all contained in acetic acid or formaldehyde, but the above suppositions lead to the conclusion that the condensate contains only about 1% carbon containing compounds. The rest is presumed to be water.

3. Gas Chromatography and Infrared Photospectroscopy Analysis⁶

A stack gas sample was examined by gas chromatography and infrared photospectroscopy. The results:

CO 0.21% by volume

CH₄ 0.00% by volume

4. Distillation of Stack Condensate

The samples were distilled according to ASTM E 133-71. Ninety seven percent was collected at 100°C and presumed to be water.

5. Orsat

Several determinations with the Orsat apparatus indicated less than 1% CO.

VII. THE CHEMISTRY OF COMBUSTION

Two traditional methods are used to determine the efficiency of radiant and convection wood burning stoves and furnaces:

1. calorimeter room; and
2. stack loss.

In the case reported here, the large water storage makes the use of the calorimeter room impossible. A more convenient method is to simply pass city water through the unit and down the sewer -- the flow and temperature rise is a measure of the output. The results of this test are reported on page 13. The material that follows describes the stack-loss method and assumes wood to consist of:

- 50.9% carbon
- 6.6% hydrogen
- 42.5% oxygen

This assumption is based on Table I, which shows the elemental content of various woods found in Maine. Table II shows some typical heating values for oven dry wood. The average heating value was taken to be 8600 Btu/lb dry wood.

The error attributed to using these average values is very slight. Suppose white cedar, having 20% moisture content on a wet basis, is burned at 100% excess air with a stack temperature of 320°F. The computed values based on the actual composition and energy content of white cedar do not vary significantly from the computed values based on the average chemical composition and energy content assumed previously. The error in computing the efficiency is only .35%.

	<u>Correct values for white cedar</u>	<u>Average values based on this paper</u>
MW (wet)	28.81	28.79
MW (dry)	30.03	30.05
Molar percentage stack CO ₂	9.018%	8.872%
Molar percentage stack O ₂	9.484%	9.450%
Stack loss	1675	1741
Efficiency	80.05%	79.74%

TABLE I
TYPICAL ANALYSIS OF DRY WOOD

	Percent by Weight					
	Carbon, C	Hydrogen, H ₂	Sulfur, S	Oxygen, O ₂	N ₂	Ash
<u>HARDWOODS</u>						
Ash, white	49.73	6.93	- -	43.03	- -	0.30
Beech	51.64	6.26	- -	41.45	- -	0.65
Birch, white	49.77	6.49	- -	43.45	- -	0.29
Elm	50.35	6.57	- -	42.34	- -	0.74
Hickory	49.67	6.49	- -	43.11	- -	0.73
Maple	50.64	6.02	- -	41.74	0.25	1.35
Oak, black	48.76	6.09	- -	44.98	- -	0.15
red	49.49	6.62	- -	43.74	- -	0.15
white	50.44	6.59	- -	42.73	- -	0.24
Poplar	51.64	6.26	- -	41.45	- -	0.65
<u>SOFTWOODS</u>						
Cedar, white	48.80	6.37	- -	44.46	- -	0.37
Cypress	54.98	6.54	- -	38.08	- -	0.40
Fir, Douglas	52.30	6.30	- -	40.50	- -	0.80
Hemlock, western	50.40	5.80	0.1	41.40	0.1	2.20
Pine pitch	59.00	7.19	- -	32.68	- -	1.13
white	52.55	6.08	- -	41.25	- -	0.12
yellow	52.60	7.02	- -	40.07	- -	0.31
Redwood	53.50	5.90	- -	40.03	0.1	0.20

Source: Wood Energy Systems, State-of-the-Art and Developing Technologies. Presented at the Future of Wood as an Energy Source, Gorham, ME, June 20-23, 1976, Dr. J. H. Fernandex, Coordinator, Environmental Control Systems, Combustion Engineering, Inc.


TABLE II
TYPICAL HEATING VALUES OF OVEN DRY WOOD¹

<u>SPECIES</u>	<u>WT/CORD</u> ²	<u>BTU/LB</u>	<u>BTU/TON</u>	<u>BTU/CORD</u> ²
White Ash	4034	8920	17,840,000	35,983,280
Fir Balsam Bark		9100	18,200,000	36,400,000
Yellow Birch	4121	8650	17,300,000	35,655,300
Yellow Birch Bark		9870	19,740,000	
White Cedar	2236	8400	16,800,000	18,782,400
Elm Bark		7600	15,200,000	
Eastern Hemlock	2722	8620	17,240,000	23,463,640
Eastern Hemlock Bark		8890	17,780,000	
Red Maple	3460	8580	17,160,000	29,686,800
Red Maple Bark		8190	16,380,000	
Oak (white)	4433	8810	17,620,000	39,063,540
Pine (yellow)	3917	9610	19,220,000	37,642,370
Pine (white)	2352	9000	18,000,000	21,168,000
Pine (white) Bark		8930	17,860,000	
Poplar	2187	8920	17,840,000	19,516,960
Poplar Bark		8810	17,620,000	

1) Source: Bulletin 1176 Forest Fuels, Inc.

2) A cord is a 4' x 4' x 8' pile of wood and is estimated to contain about 85 cubic feet of wood, the remaining volume being air space.

The stoichiometric equation for burning 100 lb of wood in air is:



where n is the number of moles of free water associated with 100 lb of dry wood, and Y is the number of moles of air supplied for each 100 lb of dry wood. Air contains 3.76 moles of N_2 for each mole of O_2 .

An oxygen balance reveals that 4.56 moles of O_2 are required for complete combustion of 100 lb of dry wood -- all carbon to carbon dioxide and all hydrogen to water.


Excess Air (EA) is defined as the percent ratio of extra air to stoichiometric air. Since oxygen is in direct proportion to total air, the number of moles of oxygen (X) supplied will fix the amount of excess air:

$$EA = \frac{X-4.56}{4.56} \times 100\% \text{ or } X = 4.56 \left[\frac{EA}{100} \right] + 1$$

The moisture content of wood on a wet basis is defined as the weight of the water in a piece of wood divided by the total weight of the wood and the water.

If the water in the products of combustion is condensed and extracted, the remaining gas is called dry flue gas. The mole fraction of each constituent of the dry flue gas is independent of the moisture content of the wood.

Putting the derived expression for X into the formula for dry flue gas yields:



This equation represents the number of moles of product for each 100 lb of dry wood burned. The molar percentage of a constituent gas is the ratio of the number of moles of that constituent gas divided by the total number of moles present in the mixture. The products are at sufficiently high temperature and low pressure to be treated as ideal gasses. The molar percentage of each constituent is therefore equal to its volume percentage.

$$y_{CO_2} = \frac{4.24}{4.24 + 17.1 \left[\frac{EA}{100} + 1 \right] + 4.56 \frac{EA}{100}} \times 100\%$$

Similarly, the molar percentage of oxygen in dry flue gas is:

$$y_{O_2} = \frac{4.56 \frac{EA}{100}}{4.24 + 17.1 \left[\frac{EA}{100} + 1 \right] + 4.56 \frac{EA}{100}} \times 100\%$$

From these two equations, the relationship between CO_2 , O_2 and excess air can be shown (see Fig. I-1).

To determine the efficiency of the wood furnace, the volume percentage of CO_2 in the stack was measured using a Bacharach Firite instrument. The amount of excess air was then determined using the above graph.

The stack-loss-efficiency curves were developed by adding up the energy above $77^\circ F$:

1. Excess air (oxygen and nitrogen)
2. Moisture content of the wood
3. Water vapor formed by burning hydrogen
4. Carbon dioxide.

This energy is the loss to be subtracted from 8600 Btu/lb of bone-dry wood.

Minor factors which were neglected are:

1. Moisture in the air
2. Ash content of the wood.


Specific heats were taken from gas tables at $300^\circ F$. The stack loss above $77^\circ F$ for each pound of wood burned is:


$$\text{loss} = \Delta H_{CO_2} + \Delta H_{N_2} + \Delta H_{O_2} + \Delta H_{H_2O}$$

$$\Delta H_{\text{gas}} = \bar{n}_{\text{gas}} \bar{C}_{P_{\text{gas}}} \quad (\text{stack temperature} - 77)$$

$$\Delta H_{H_2O} = \bar{n}_{H_2O} (h_{\text{stack}} - h_{77^\circ F})$$


$$\text{Efficiency} = \frac{8600 \frac{\text{Btu}}{\text{lb}} - \text{loss} \frac{\text{Btu}}{\text{lb}}}{8600 \text{ Btu/lb}}$$

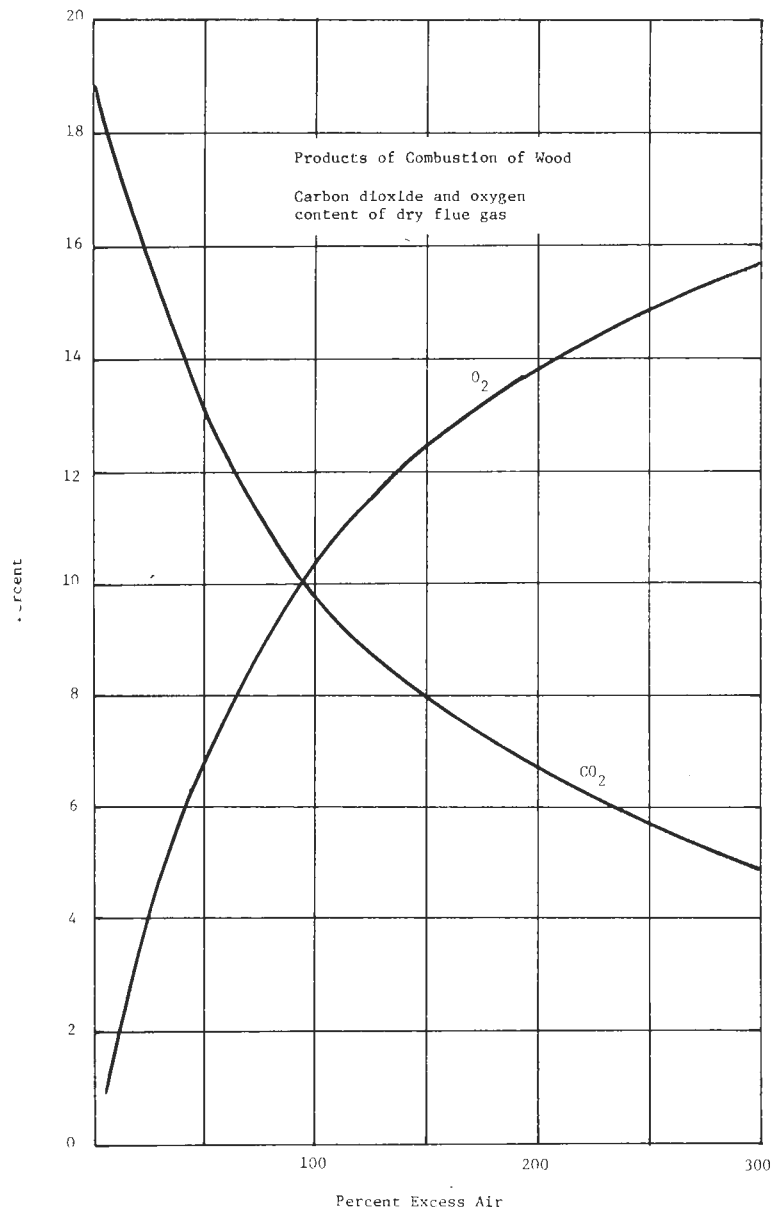

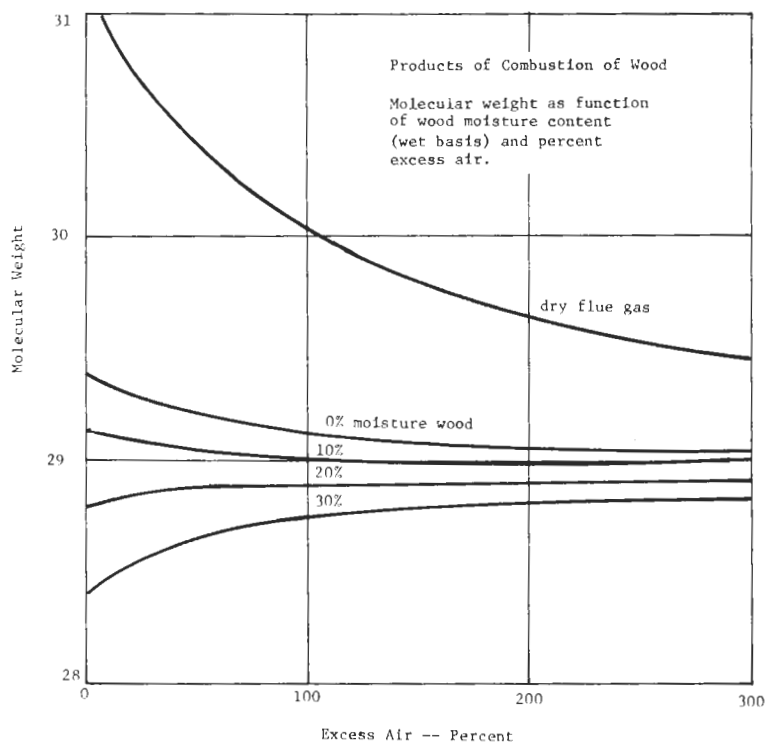


I-5

The Efficiency and Stack Loss from the Complete Combustion of wood as a Function of Stack Temperature and Percent Excess Air.

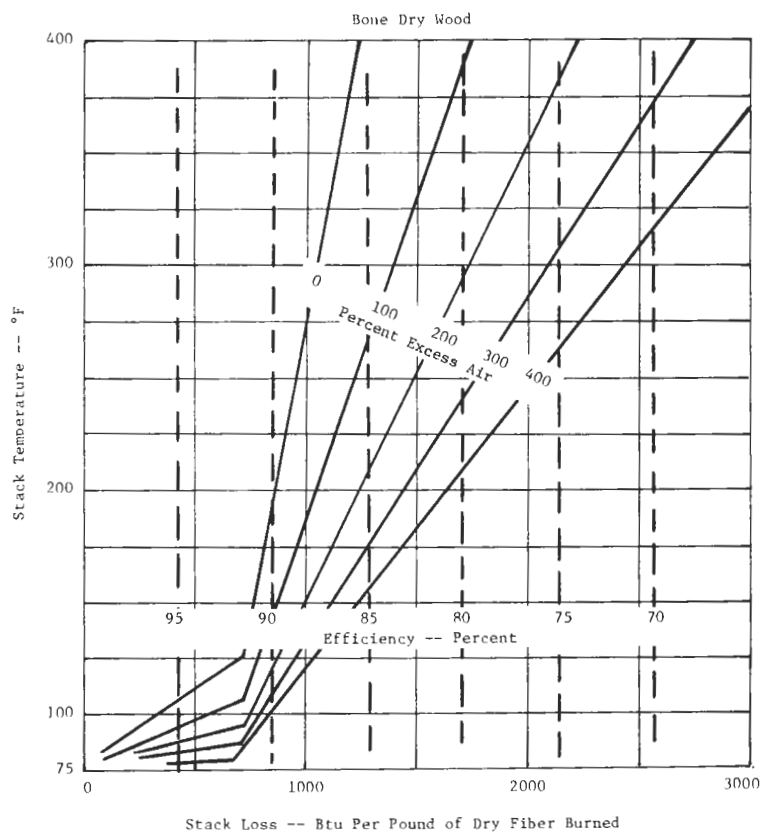


The Efficiency and Stack Loss from the Complete Combustion of Wood as a Function of Stack Temperature and Percent Excess Air.

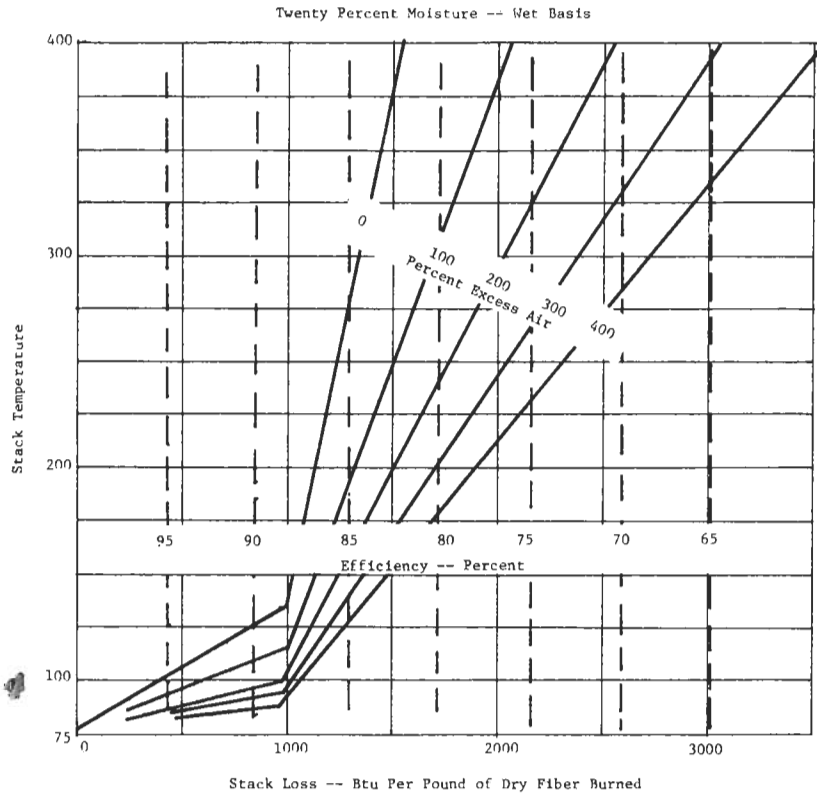

I-7

The Efficiency and Stack Loss from the Complete Combustion of Wood as a Function of Stack Temperature and Percent Excess Air.

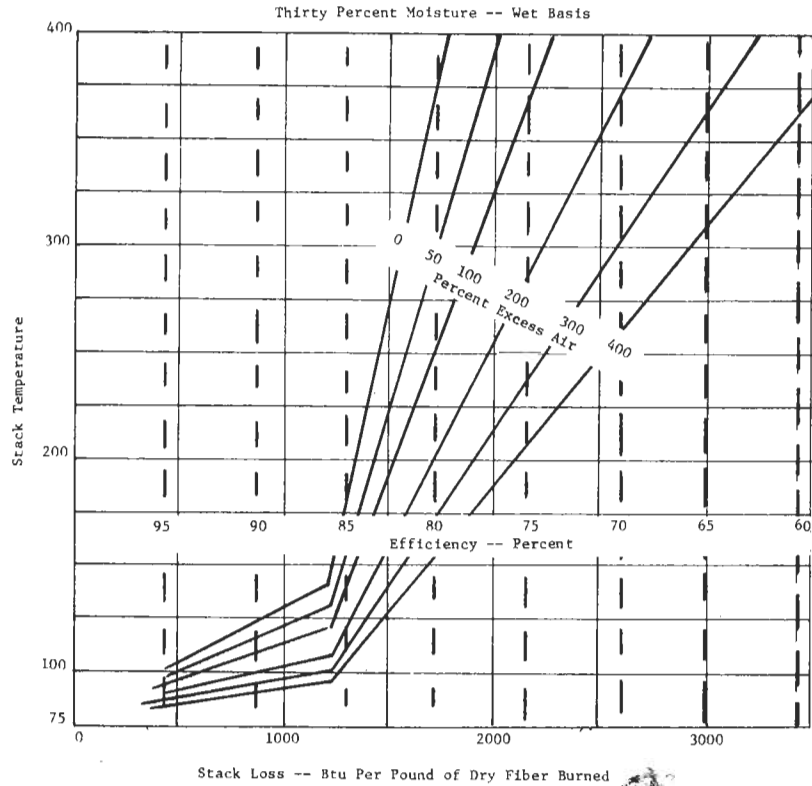

APPENDIX

VERMICULITE CONCRETE AND REFRACTORY

1. Introduction

The case of the UMO furnace is cast of vermiculite concrete. Vermiculite is a mineral containing mica, which, as mined, has a laminated structure with combined water. During manufacture the material is heated; the combined water turns to steam, providing an expanded light-weight aggregate.

Vermiculite aggregate can be used along with conventional aggregate to make concrete having a density ranging from 15 to 90 lb/ft³.¹ The "R" value* of vermiculite concrete increases with decreasing density and can range from 0.3 to 2.0 as compared to normal weight concrete which has a density of around 120 lb/ft³ and an "R" value of about 0.1. The compressive strength of the concrete is directly proportional to the density.²

2. How to Mix Vermiculite Concrete

The vermiculite aggregate was mixed to meet ASTM C332-66 standard specification for light-weight (no conventional aggregate -- all vermiculite) insulating concrete. Vermiculite is available through masonry suppliers or through W. R. Grace and Co., 62 Whittemore Ave., Cambridge, MA 02140 and is available in five grades. Expanded #1 is the coarsest and expanded #5 is the finest.

Expanded #3 aggregate may be used or, if #3 is unavailable, expanded #1 and #5 may be mixed. If #1 and #5 are to be used, the #1 aggregate must first be passed through a #4 (1/4" opening) U.S. standard sieve to break up the largest pieces. The large pieces are easily pushed through the mesh by hand or with a block of wood.

The proportions are: 8 parts vermiculite; 1 1/2 parts Portland cement; and 3 1/2 parts water. Following is the procedure for mixing a batch:³

1. Mix equal volumes of sifted #1 and #5 aggregate or, if available, use #3 aggregate.
2. Place half the water into the mixer.
3. Add all the cement and mix to a thin, soup-like consistency.
4. Add the vermiculite. The mix will become dry as the vermiculite absorbs water.
5. Add additional water and 2 oz of air entraining agent (available at any ready-mix concrete plant) until the mix becomes workable (the consistency of shaving cream is about right). This must be done slowly and carefully -- the material can become too soupy if care is not taken.

Above 1000°F Portland Cement bonded concretes rapidly lose strength.⁴ The free lime released on firing can cause crumbling when the concrete is submitted to thermal cycling with intervening periods of moist air. The best combination of refractory material and vermiculite concrete will not be known until tens of thousands of hours are accumulated on production units. At this time the recommendation is:

* $\frac{\text{hr-ft}^2\text{-}^\circ\text{F}}{\text{Btu-in}}$

1. Two-inches Plicast 27 around the combustion chamber.
2. One-inch Plicast around the tunnel.
3. Two-inches LWI-20 under the heat exchanger.
4. All the rest, vermiculite concrete.

3. Refractory Characteristics

(Plibrico Company, 1800 Kingsbury St., Chicago, Ill. 60614)

Property	Plicast 27	LWI 20
Recommended service range	200-2500 ^o F	200-2000 ^o F
Weight	120 lb/ft ³	52 lb/ft ³
Thermal conductivity (1500 ^o F)	5.7	1.7
$\frac{\text{Btu-in}}{\text{hr-ft}^2\text{-}^{\circ}\text{F}}$		

NOTES

1. ASTM C332-66 Standard Specifications for Lightweight Insulating Concrete.
2. Design and Control of Concrete Mixtures, 11th ed., Portland Cement Association, 5420 Old Orchard Rd., Skokie, Illinois, 60076. Pp 90, 101.
3. Zonolite Brand Vermiculites, Properties and Uses. W. R. Grace and Co., Construction Products Division, 62 Whittemore Avenue, Cambridge, MA, 02140.
4. Refractory Concrete, Publication SP-57 Am. Concrete Institute. Detroit
5. Loundsbury, A.K., Department of Civil Engineering, University of Maine, in correspondence with Richard C. Hill, March 14, 1979.
6. Wolfhagen, J.L., Professor of Chemistry, University of Maine, in correspondence with Richard C. Hill, July 30, 1979.
7. Shelton, J.W., Black, T., Chaffee, M. and Schwartz, M. Wood Stove Testing Methods and Some Preliminary Experimental Results, ASHRAE Transactions, Vol. 48, Part 1, 1978. At-78-1, No. 2.
8. Shelton, J.W., The Woodburners Encyclopedia, Vermont Crossroads Press, Waitsfield, Vt., p. 58 and Appendix 4.
9. Cassiday, M. An Analysis of the Stack Energies from the Complete Combustion of Wood, Dept. of Mechanical Engineering, University of Maine, Orono, ME, 04469, Dec. 6, 1978. Dist. by Dept. of Industrial Cooperation, University of Maine.

243 College ~~At~~ d.d. *Richard C. Hill*
To readers of Mechanics Illustrated requesting information on the University of Maine
wood burning furnace:

866-2204

The commitment to supply "complete technical information" is an overstatement. We have four units under test - two are working without difficulty; one is a modest success; and, at this point at least, we have one failure. We are not ready to release complete design data until we are more certain of all the variables. Our contract with the U.S. Department of Energy calls for such a document to be published next fall. We will notify you of its availability.

The following statement is a little more explicit than the Mechanics Illustrated piece and may be useful in a better understanding of how the unit works.

STICK WOOD FURNACE RESEARCH AT THE
UNIVERSITY OF MAINE AT ORONO

Conducted with funds from the U.S. Department of Energy
Professor Richard C. Hill, 109 Boardman Hall, University of Maine, 04469

THE PROBLEM OF BURNING WOOD

A series of very complex time-and-temperature-dependent chemical reactions accompany the burning of wood. To supply the correct amount of air is difficult; to control the output to match a particular heating load is impossible. This difficulty in carburetion and control is compounded by difficulties in ignition. The pyrolysis gases generated from heating wood have an ignition temperature between 725^oF (methanol) and 1128^oF (carbon monoxide). Since stove surface temperatures do not operate in this range, much of the gas distilled from wood is vented to the chimney with three unhappy consequences:

1. the loss of energy
2. the pollution of the atmosphere
3. chimney condensation with subsequent fire hazard.

As a stick of wood is burned heat is transferred from the surface to the interior with a counter flow of pyrolysis material. The kinetics of the reaction depend upon

1. surface to volume ratio of the stick
2. surface temperature
 - a. radiant field
 - b. convection field
3. wood moisture
4. specie
5. rate of air supply
6. rate of ash removed from the burning surface.

Given this complexity the only design approach is to cut and try. The only design rule is to keep the combustion zone hot and turbulent for a sufficient time to complete the reaction.

*The furnace is operated each Wednesday
at 3:30 pm - for interested persons -*

At the start of the present work we tried several arrangements of all refractory combustion chambers without real success. Regardless of how we introduced the air or stacked the wood the radiative capacity of the refractory would force carburetion problems that would sometime result in explosions strong enough to lift a 20 pound cast refractory charging door.

The present design uses a water-jacketed combustion chamber with a refractory base. The combustion air is introduced at several inches of water static pressure. The resulting high velocity impingement on the burning wood tends to blow away the ash formation on the surface, expose unburned material at a fairly constant rate, and promote a constant rate of heat release.

The flame leaves the refractory base through a refractory tunnel 7 1/2" wide, 3 1/2" high and 14" long (the unit will burn about 25 lb of 20% moisture wood per hour). The length of the tunnel is important:

1. the incandescent tunnel walls are necessary to provide ignition for the small drops of tar and carbon that are driven from the wood.
2. the heat exchanger must "see" the flame for radiant heat transfer, but the flame must not be quenched by the walls of the heat exchanger or carbon deposits will result.

The present configuration does not pay a penalty for carbon deposits which means that the heat exchanger may not absorb as much radiant energy as would be possible with a shorter tunnel.

The ideal design would allow the flame to reach the heat transfer section for good radiant transfer, but without impinging on the surfaces to force the loss of ignition.

PERFORMANCE

During the firing cycle excess air will range between 30% and 50%.; the stack temperature between 350 and 400^oF. If the wood has 20% moisture on a wet basis the efficiency will be about 80%. This is based on an "input" of 8,600 Btu per bone dry pound and losses based on the enthalpy of the stack gas at the heat exchanger exit. The fraction of useful energy that enters the water jacket is uncertain as we have not yet insulated the heat exchanger or storage tank. But each pound of wood burned will force a one degree F temperature rise in the total system which is about the equivalent of 600 gal of water. This rise will be higher once insulation is installed. A 20 ft section of 6 inch smoke pipe between the heat exchanger and chimney drops the temperature 150^oF resulting in a four point improvement in efficiency. As additional heat transfer surface is added a point will be reached when the increasing pressure drop and decreasing stack bouyancy will require an emergency battery operated ID fan to keep smoke from entering the building in the event of a power failure.

There are no problems with carbon or tar deposits on the heat exchanger in spite of some hostile testing procedures. City water at 60^oF was introduced into the heat exchanger and discharged at 120^oF. Most of the surface is therefore below the dew point of the water vapor in the stack gas. After a thousand pounds of wood were burned the unit was disassembled. The surfaces were only dust covered, and a cloth could expose the parent metals. The combustion chamber interior, however, is coated with tar deposits which build up and flake off.

The upper portion operates under the fuel-rich, air-lean condition experienced by traditional wood burning equipment. Several gallons of condensate were removed from the stack by a condensing heat exchanger that cooled the gas to about 60°F. The condensate was over 99% water and the pH ranged from 7 to 8. A sample of the condensate was evaporated at room temperature. The residual was 0.3 percent of the original sample. The start-up performance with cold heat exchangers and cold refractory will cause several minutes of smoky operation, but once the refractory is hot the smoke disappears.

OPERATION & SAFETY


The induced draft fan means easy start up: some paper, kindling, a match and a fire will be established in a few minutes. Forty pounds of stick wood can be loaded almost at once. Stack temperature and heat release rate will stay almost constant for the two-hour burn. Additional wood can be added at any time without changing the steady-state output. If the forced draft fan is shut off the induced draft fan will pull building air in the open charging door and no smoke will enter the building. The performance is only slightly sensitive to the size of sticks fired. A bundle of 2 inch diameter branches or a single unsplit log will both burn satisfactorily. The small sticks may require a reduced air flow to prevent fuel-rich, air-lean mixtures from "bumping" (a euphemism for small explosions within the combustion chamber that drive smoke out around the charging door). The single log will burn only if introduced into an already red hot refractory base; a small penalty is paid, however, for excess air. No high limit control is needed as the 500 gal storage tank will absorb a full wood charge without overheating. The expansion tank is open to the atmosphere; so no over-pressure is possible. The complete combustion will not permit chimney deposits -- chimney fires are impossible. A thermostat in the stack will shut off the forced and induced draft fan when the stack temperature falls to 250°F. At this point only coals are left in the combustion chamber. Again stack draft will keep odors from the building.

The 500 gal tank will store 500,000 Btu which will protect a building for several hours or several days (depending on the building and the weather) against building freeze up. If building thermostat set-back is used the recovery rate can exceed the capacity of the burner because the tank temperature can be reduced at the same time the unit is being fired. No circulator pump is needed for safety as piping is sized for gravity circulation. With R20 insulation a 500 gal tank will lose only 500 Btu/hr with a 100°F temperature difference tank to ambient; so heat loss from storage is not critical. After the tank is heated and the wood fire is out the air flow through the combustion zone is close to zero. There is no stand-by penalty such as that paid by an oil or gas furnace.


SOME PROBLEMS

A conventional air-tight stove requires careful design and construction to prevent uncontrolled in-leakage. This problem is much more critical with the design described here. The induced draft fan produces a vacuum in sections of the system far greater than what natural draft can produce. We were forced to abandon an ash cleanout door for example; we could not keep it sufficiently leak tight.

The safety of the system depends upon the open expansion tank which means that adaptation to existing two story houses is difficult. We chose a 500 gal oil tank for storage. In an existing dwelling the tank would be constructed in place. We have made a 600 gal concrete block tank lined with extruded polystyrene and BLOCKBOND which is satisfactory, but the cover seal is difficult to construct and the pressure is limited to the level of water in the tank.

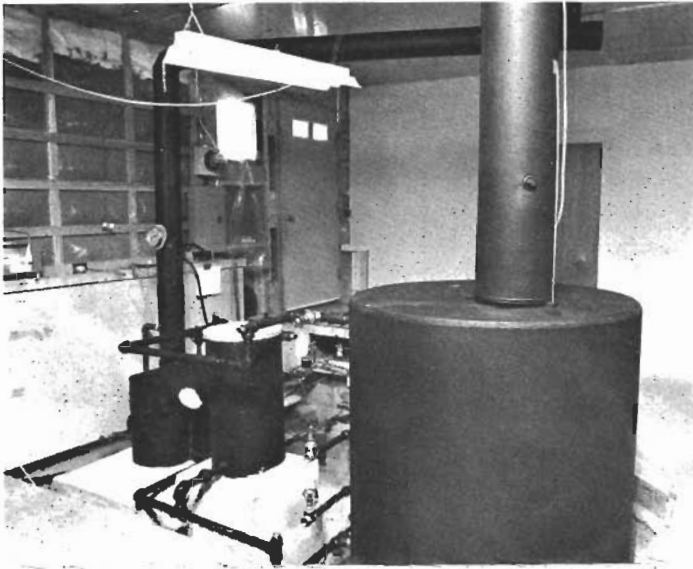

Storage tank in foreground; expansion tank on top.

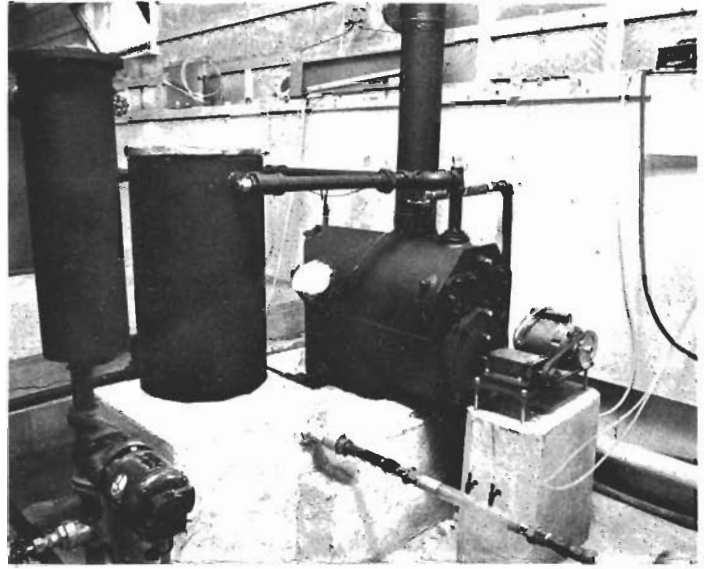

Induced draft fan is part of heat exchanger. Forced draft air passes through Venturi meter.




Wood burns in the refractory zone only.



Fuel being added to combustion chamber.

1/4" pipe
250 water


Back up hot water only
Switch from hot water heater

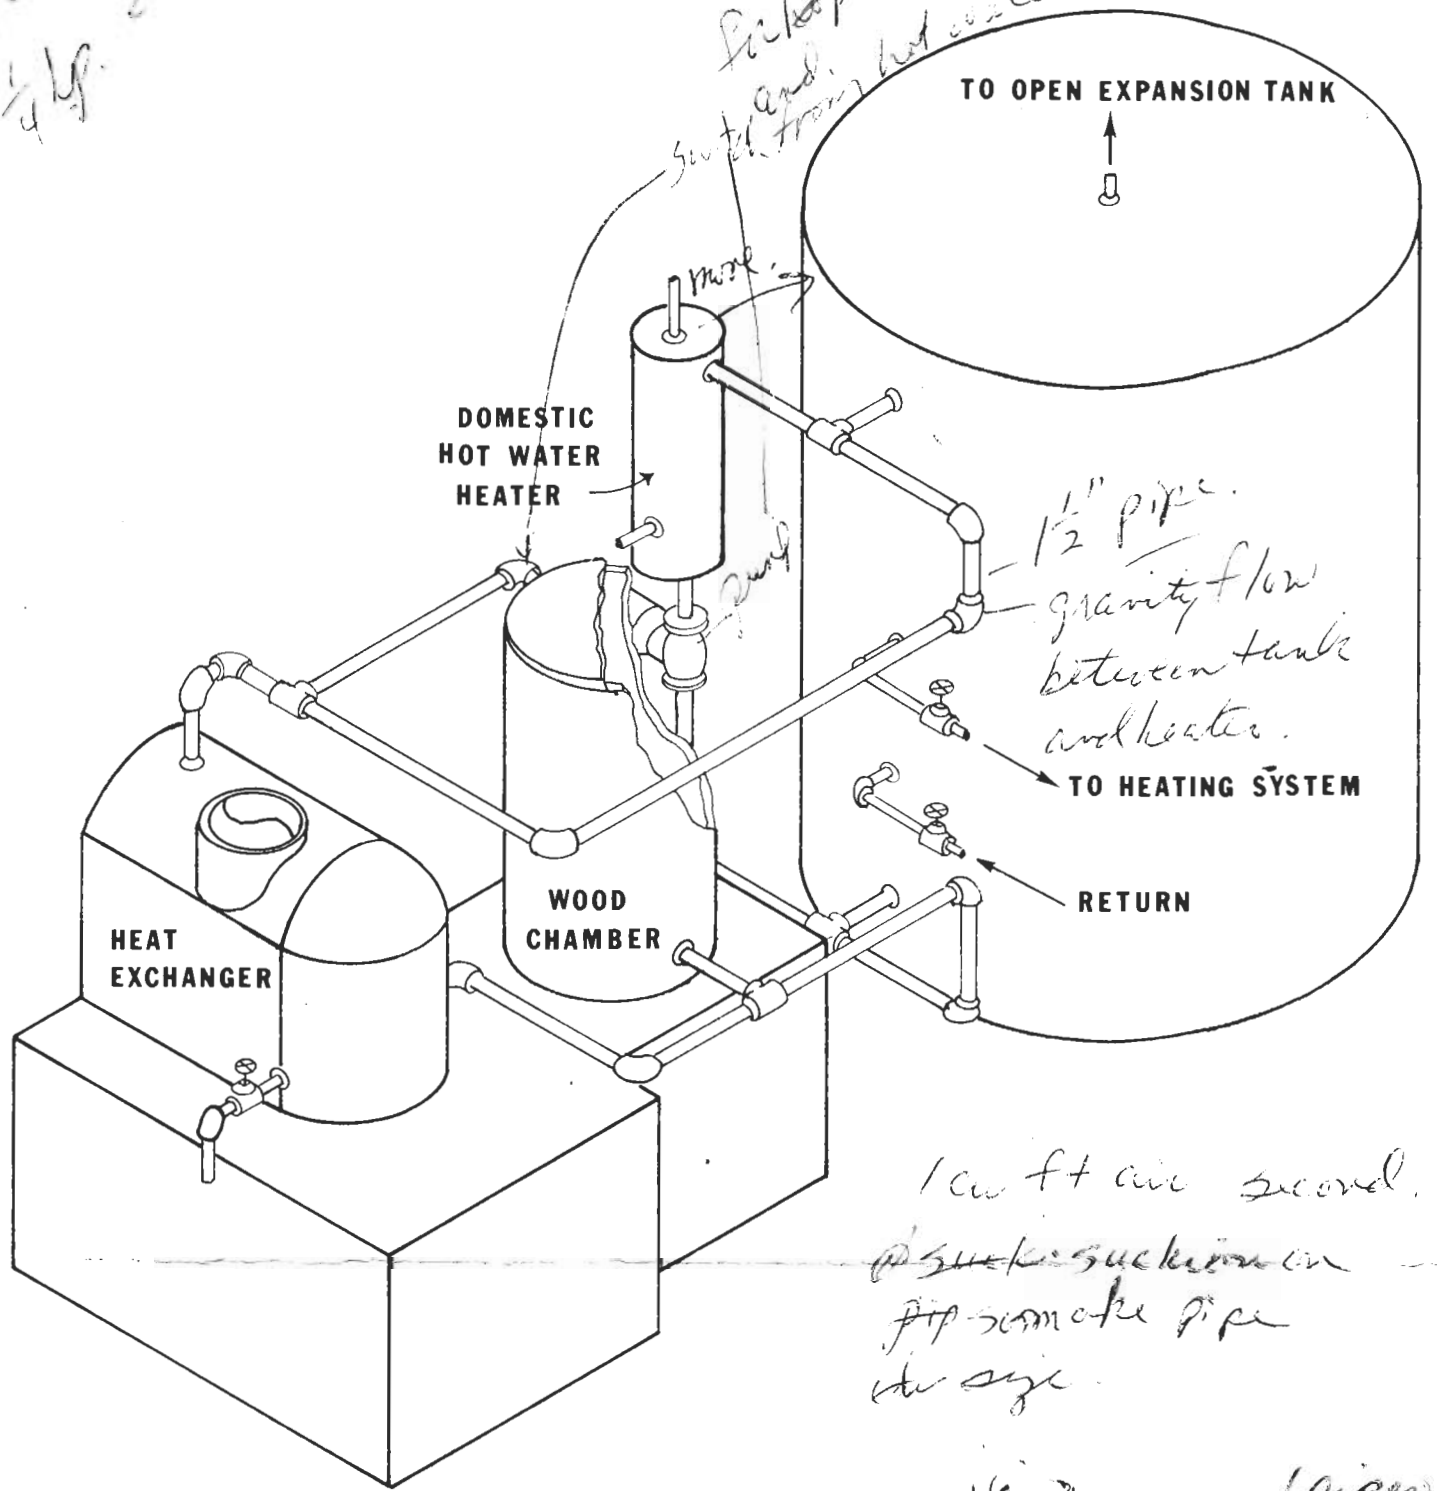


1 cu ft air second.
@suck suction on
fire smoke pipe
the size.

WOOD BURNING PIPING LAYOUT


heat exchanger

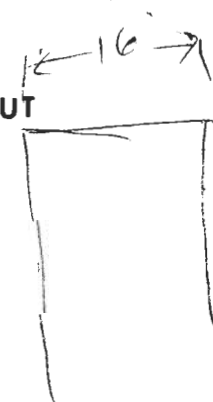

1 pipes
2 1/2" pipe
does not work
use smaller tabs.

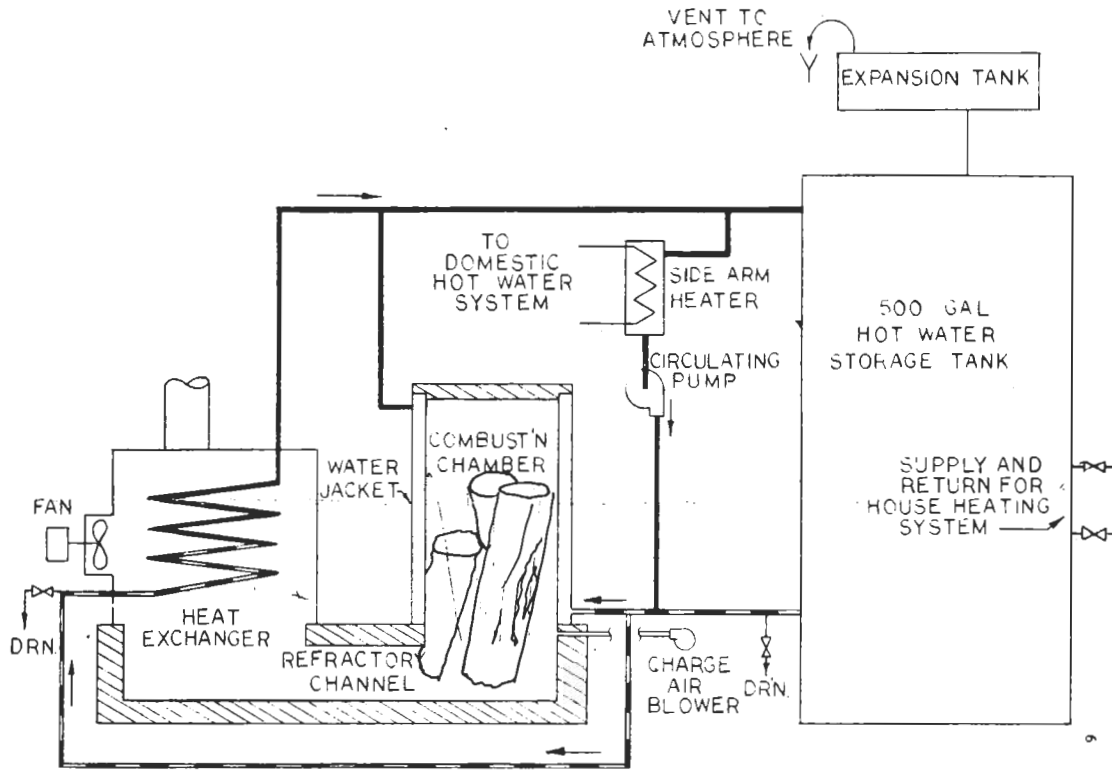


SCHEMATIC

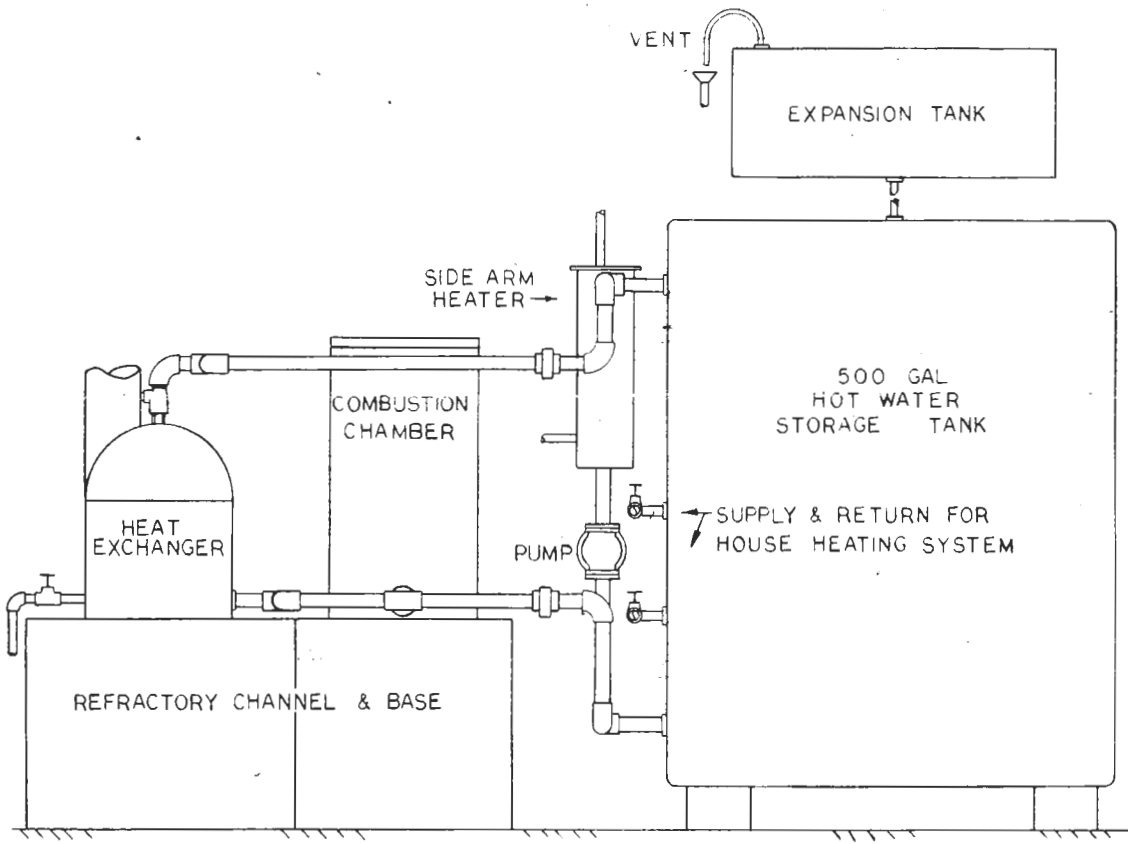


ELEVATION

SCALE: 1" = 1'-0"

scale not true

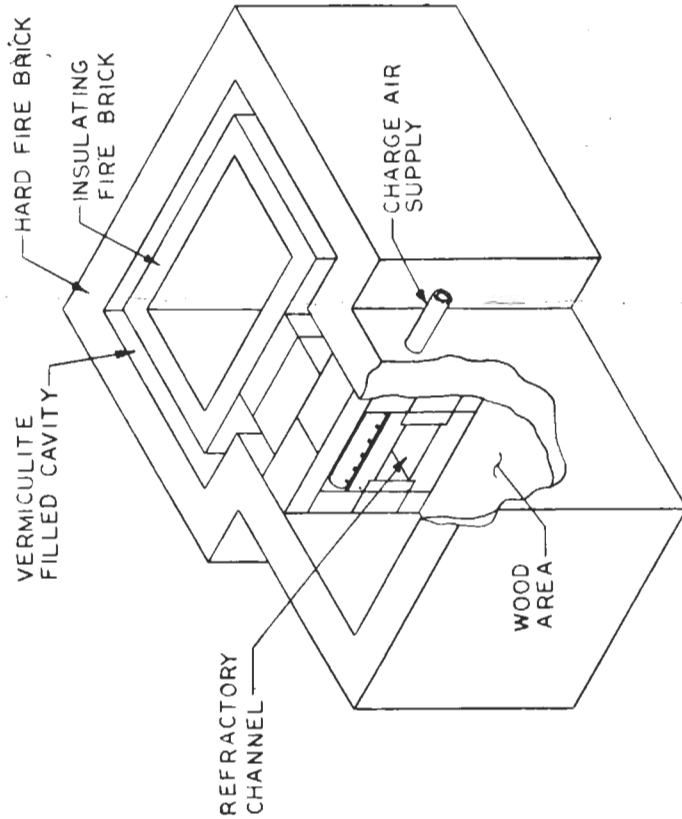

VIEW OF REFRACTORY FOUNDATION UNDER WOOD CHAMBER AND AXEMAN-ANDERSON UNIT

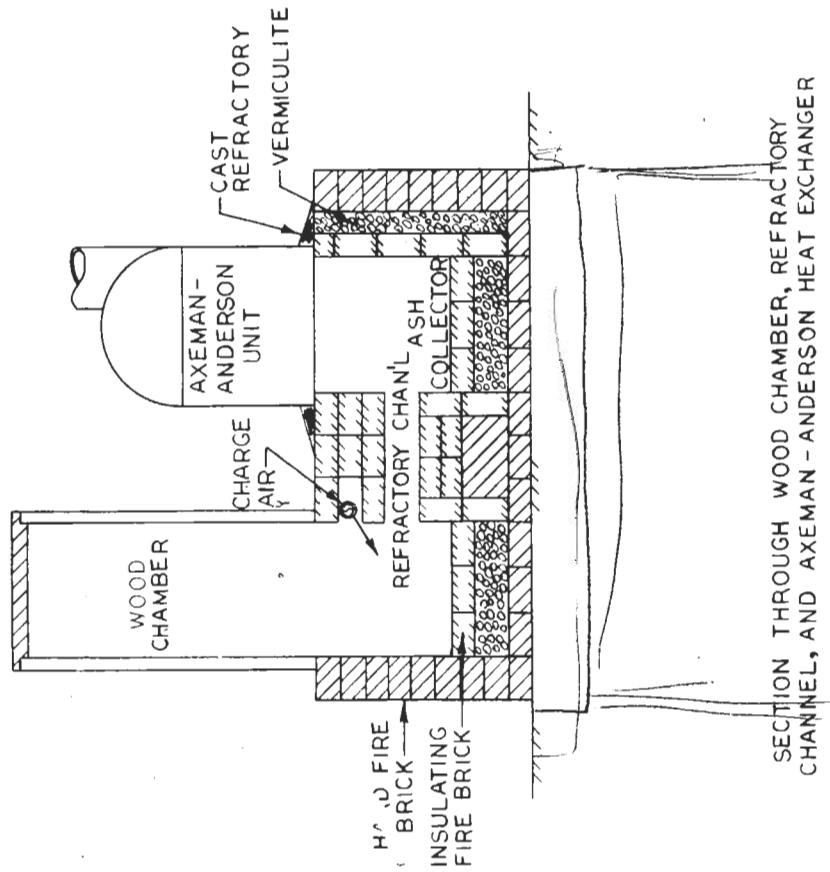

SECTION THROUGH WOOD CHAMBER, REFRACTORY CHANNEL, AND AXEMAN-ANDERSON HEAT EXCHANGER

*60 cfm
3 water pressure*

10/10/59